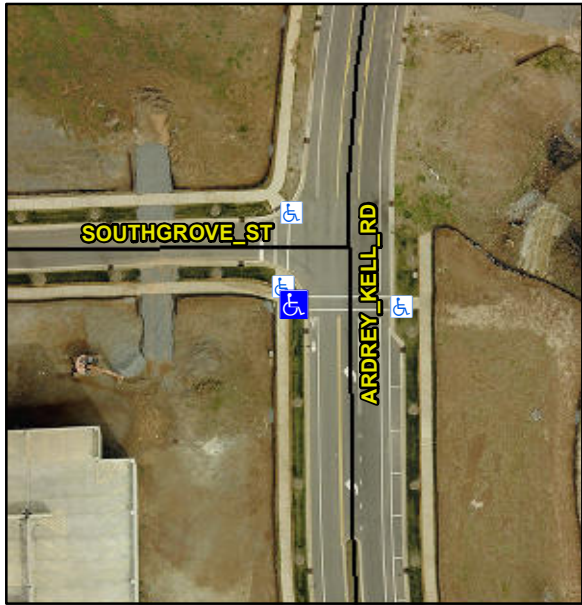


Access Compliance Report

Public Rights-of-Way

(Curb Ramps)

Intersection ID: N/A	Main Street: SOUTHGROVE_ST	Cross Street: ARDREY_KELL_RD	Location: SW
ADA ID: 1C5800884051	Ramp Type: Directional1	Initial Pass/Fail: Fail	Overall Compliance: No
			Severity Score: 13.75

Codes/Mitigation Info/Possible Solution			Field Measurements/Component Compliance					
	Possible Solutions:		Compliance	Description	Data	Compliance	Description	Data
	Remove & Replace Entire Ramp.		N/A	Ramp Length (in)	82.0	N/A	Grade Break?	N/A
			Yes	Ramp Width (in)	57.0	N/A	Grade Break Slope (%)	0.0
			No	Ramp Slope (%)	8.9	N/A	Grade Break XSlope (%)	0.0
			No	Ramp XSlope (%)	3.6			
			N/A	Flare Type LT	N/A	N/A	Flare Type RT	N/A
			N/A	Flare Slope LT (%)	N/A	N/A	Flare Slope RT (%)	0.0
			N/A	Flare Traversable LT?	N/A	N/A	Flare Traversable RT?	N/A
	Surveyor Notes:		N/A	Landing Length (in)	0.0	N/A	DWS Provided?	N/A
			N/A	Landing Width (in)	0.0	N/A	DWS Contrast?	N/A
			N/A	Landing Slope (%)	0.0	N/A	DWS Length (in)	N/A
			N/A	Landing X Slope (%)	0.0	N/A	DWS Full Width?	N/A
	PROW/ADA:		N/A	Landing Curb? (Y/N)	N/A	N/A	DWS Offset LT (in)	N/A
	R304.2.2, R304.5.3		N/A	Shared Landing?	N/A	N/A	DWS Offset RT (in)	N/A
			N/A	Gutter Ponding?	0.0	N/A	Gutter Slope (%)	N/A
			N/A	Gutter Lip Ht (in)	0.0	N/A	Gutter X Slope (%)	N/A
			N/A	Painted X Walk1?	Yes		Road Slope (%)	0.4
				X Walk 1 Direction	To NE		Road X Slope (%)	0.3
				X Walk 1 Width (in)	71.0		Clear Space?	N/A
				X Walk 1 Slope (%)	0.4	N/A	Clear Space to XWalk (in)	N/A
				X Walk 1 X Slope (%)	0.3	N/A	Storm Grate/Utility Hazard?	N/A
			N/A	Ramp inside XWalk1?	Yes		Storm Grate/Utility Type	
			N/A	Any Obstructions?	N/A			N/A
				Obstruction Type		Yes	Surface Condition? (G/P)	Good
						N/A	Curb Slope (%)	10.5
Street 1 Name		ARDREY KELL RD						
Stop Condition-Street 1		None						
Street 2 Name		N/A						
Stop Condition-Street 2		N/A						
Total Cost:			\$	1600.00				

