

Access Compliance Report


Public Rights-of-Way

(Curb Ramps)

Intersection ID: 7243	Main Street: N_GRAHAM_ST	Cross Street: S_I-85_EXIT_40_RA	Location: S
ADA ID: DF50E52CCF4E	Ramp Type: BlendTrans1	Initial Pass/Fail: Pass	Overall Compliance: No
		Severity Score: 0	

Codes/Mitigation Info/Possible Solution

Field Measurements/Component Compliance

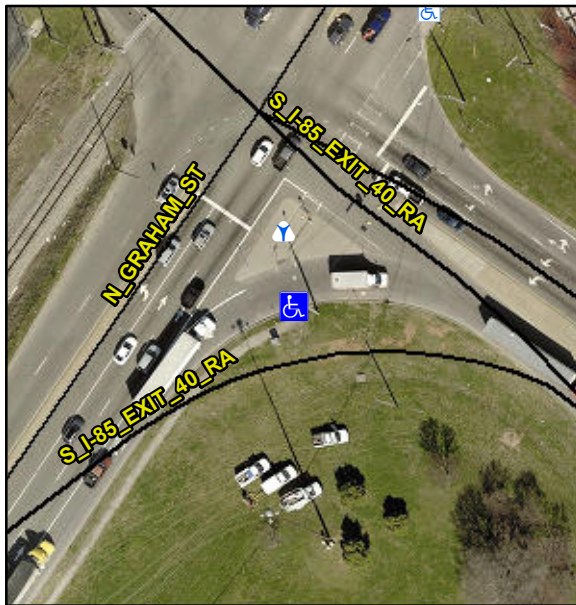

Possible Solutions:

Remove & Replace Curb Ramp With Two New Directional Ramps or Equivalent. Remove & Replace Gutter.

Surveyor Notes:

NO LT SW

PROW/ADA:

Not Found, R304.2.2-Perp, R304.3.2-Para, R304.5.3, R305.1.4, R305.2

Street 1 Name	S I-85 EXIT 40 RA
Stop Condition-Street 1	YieldSign
Street 2 Name	N/A
Stop Condition-Street 2	N/A

Total Cost: \$ 3950.00

Compliance	Description	Data	Compliance	Description	Data
N/A	Ramp Length (in)	72.5	Yes	BlendTrans Slope (%)	3.4
Yes	Ramp Width (in)	48.0	Yes	BlendTrans XSlope (%)	1.9
N/A	Flare Type LT	Sloped	N/A	Flare Type RT	Sloped
N/A	Flare Slope LT (%)	1.8	N/A	Flare Slope RT (%)	7.1
N/A	Flare Traversable LT?	No	N/A	Flare Traversable RT?	No
Yes	Landing Length (in)	48.0	Yes	DWS Provided?	Yes
Yes	Landing Width (in)	49.0	Yes	DWS Contrast?	Yes
No	Landing Slope (%)	4.7	No	DWS Length (in)	23.5
No	Landing X Slope (%)	3.4	Yes	DWS Full Width?	Yes
N/A	Landing Curb? (Y/N)	No	No	DWS Offset (in)	5.5
N/A	Shared Landing?	No			
Yes	Gutter Ponding?	No	Yes	Gutter Slope (%)	1.7
Yes	Gutter Lip Ht (in)	0.0	No	Gutter X Slope (%)	2.6
N/A	Painted X Walk1?	Yes	N/A	Painted X Walk2?	N/A
	X Walk 1 Direction	To N		X Walk 2 Direction	N/A
	X Walk 1 Width (in)	112.0		X Walk 2 Width (in)	N/A
	X Walk 1 Slope (%)	6.9		X Walk 2 Slope (%)	N/A
	X Walk 1 X Slope (%)	1.5		X Walk 2 X Slope (%)	N/A
Yes	Ramp inside XWalk1?	Yes	N/A	Ramp inside XWalk2?	N/A
	Road Slope (%)	1.5		Clear Space?	Yes
	Road X Slope (%)	6.9	N/A	Clear Space to XWalk (in)	N/A
Yes	Any Obstructions?	No	Yes	Storm Grate/Utility Hazard?	No
	Obstruction Type			Storm Grate/Utility Type	
		N/A			N/A
			Yes	Surface Condition? (G/P)	Good
			No	Curb Slope (%)	15.6

